
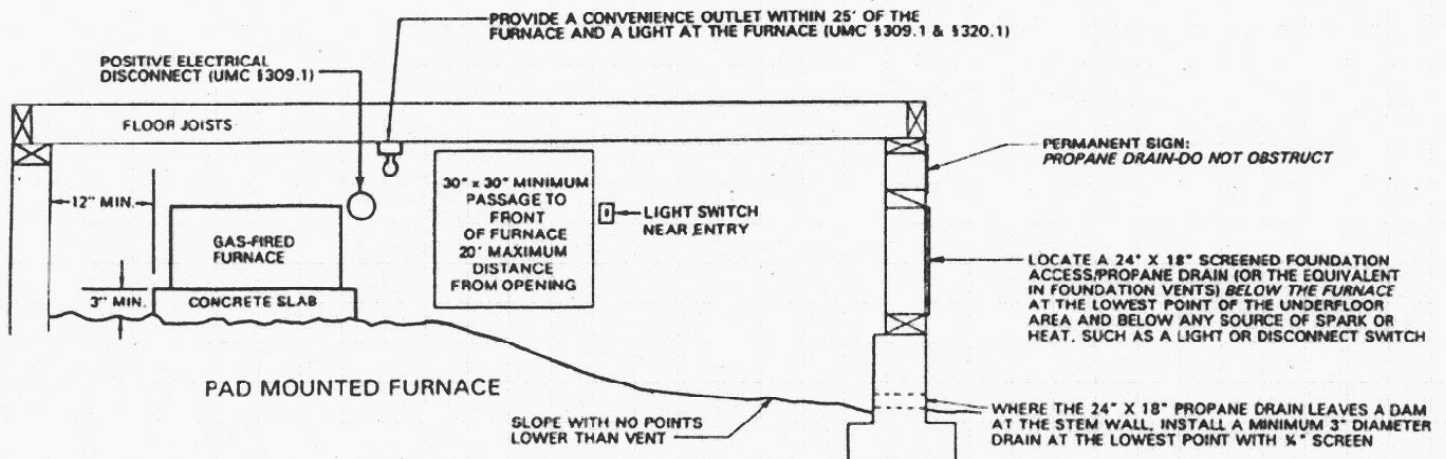


PROPANE APPLIANCE

PROPANE APPLIANCE INSTALLED ABOVE-GRADE UNDER-FLOOR SPACE FOR AREAS BELOW 2,500 FOOT ELEVATION

NOTE: In areas above 2,500 foot elevation the designer of the building must specify an acceptable method of compliance with the Uniform Mechanical Code §304. This must include the method of protecting the propane drain from snow accumulation such that unburned gas is permitted at all times to escape the building. Where the propane drain is below the maximum anticipated snow depth (see Placer County Code, Table A-16-C), the design of the system must be done by a California licensed mechanical engineer.

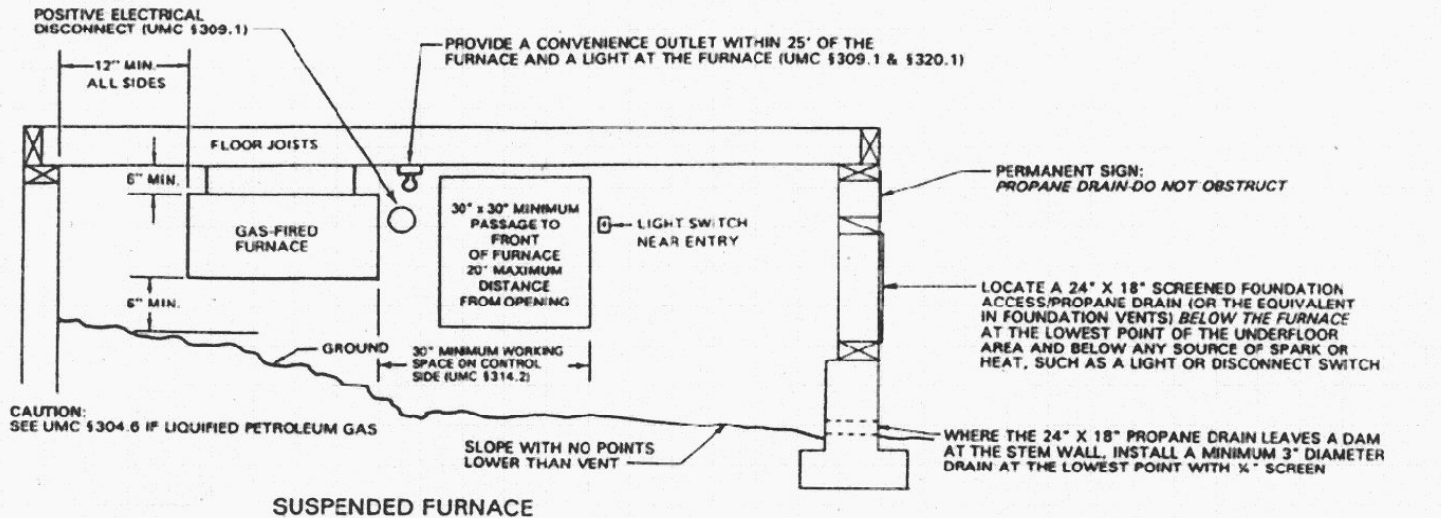

Uniform Mechanical Code §304.6 - Liquified Petroleum Gas Appliances:

"Liquified petroleum gas-burning appliances shall not be installed in a pit, basement or similar location where heavier-than-air gas might collect. Appliances so fueled shall not be installed in an above-grade under-floor space or basement unless such location is provided with an approved means for removal of unburned gas."



**PLACER COUNTY
BUILDING DEPARTMENT
AUBURN, CALIFORNIA**

2001 CALIFORNIA MECHANICAL CODE
SECTION 304.6

DATE: NOVEMBER 1, 2002